

NOTES

NOTE:

THE POSITIONING AND DIMENSIONS OF THE EQUIPMENT INDICATED IN THE PROJECT ARE INDICATIVE AND MUST BE VERIFIED ON SITE WITH THE WORKS MANAGEMENT;
 NB: ALL EQUIPMENT MUST BE INSTALLED IN STRICT COMPLIANCE WITH THE INSTALLATION MANUALS FOR THE EQUIPMENT;
 NB: DRAWING NOT VALID FOR ARCHITECTURAL PURPOSES


















NOTE:

FOR PLUMBING, THERMAL, ELECTRICAL AND ELECTRONIC CONNECTIONS FOLLOW SCRUPULOUSLY FOLLOW THE INSTRUCTIONS OF THE MANUFACTURERS OF THE PRODUCTS AND THE REGULATIONS IN FORCE REGARDING SAFETY AND CORRECT INSTALLATION OF THE SYSTEMS


NOTE:

THE POSITION OF THE COMPONENTS OF THE MECHANICAL SYSTEM SHOWN IN THE DIAGRAMS IS PURELY INDICATIVE; IT WILL HAVE TO BE VERIFIED DURING CONSTRUCTION ACCORDING TO ACTUAL NEEDS.


CAPTION

-  HEAT PUMP A/W
THERMICS DURAN 15/20 KW MB 2T
-  1 SINGLE COIL BOILER
Type HP R1 300 I
-  2 STORAGE PUFFER
Type HC 200 I
-  DISTRIBUTION GROUPS AND
RELAUNCH PLANT ZONES
-  SYSTEM DELIVERY PIPING
-  SYSTEM RETURN PIPING
-  DHW DELIVERY PIPE
-  DELIVERY PIPING DCW
-  1 ANTI-VIBRATION JOINT
-  2 DEFANGER
-  3 NON-RETURN VALVE
-  4 3-WAY DIVERTER VALVE
-  5 SAFETY VALVE
-  6 MANOMETER
-  7 ACS EXPANSION TANK 35I
-  8 RADIANT FLOOR
-  9 AMBIENT THERMOSTAT

ELECTRICAL CONNECTION DIAGRAM

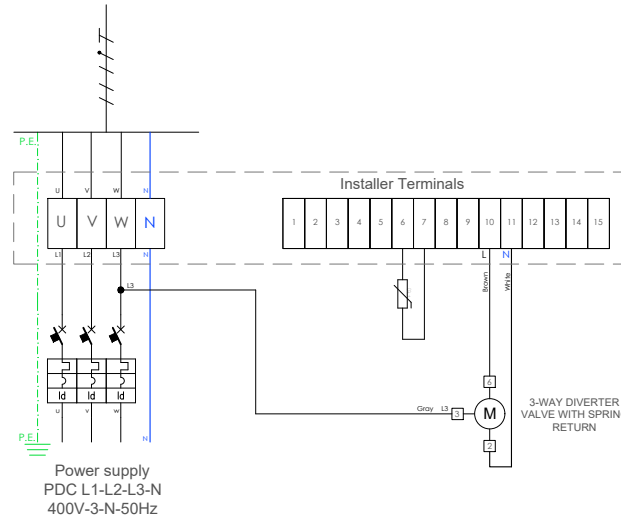

HYDRAULIC SCHEME

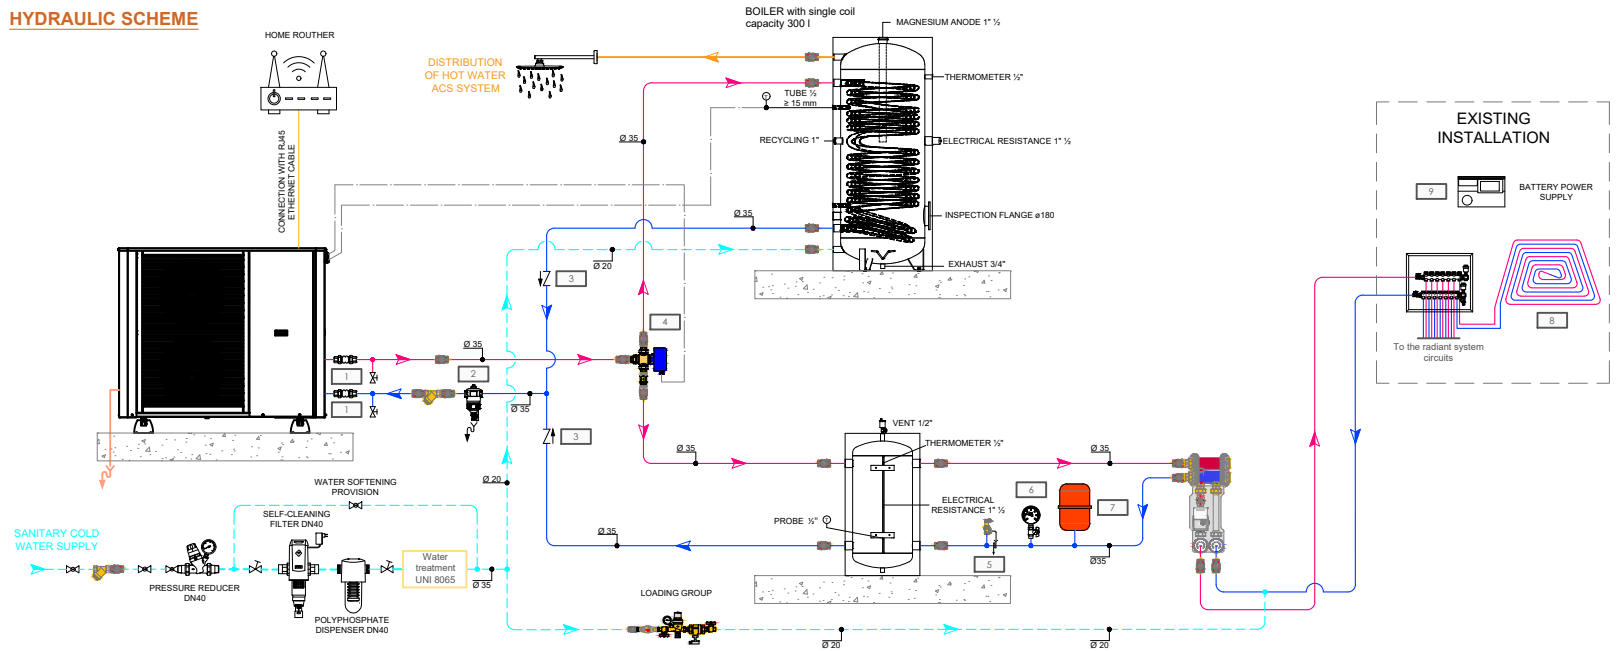

Property of Thermics Energie - All Rights reserved

FUNCTIONAL DIAGRAM
DURAN 15/20 MB 2T

FOGLIO 1	BY AC	DATE 14/12/2023	CLIENT /
DRAWING/REVISION 00		PLANT/SITE FUNCTIONAL DIAGRAM	

Thermics Energie srl
 www.thermics-energie.it
 E-mail: info@thermics-energie.it

